



**City of St. Helena
Parks and Recreation Commission
Regular Meeting
Monday, April 20, 2020 @ 4:30 PM**

In accordance with Executive Orders N-25-20, N-29-20, and guidance from the California Department of Public Health on gatherings, remote public participation is allowed. We will address the Order in the following ways: Members of the public may not physically attend meetings. The Parks and Recreation Commission meeting will be live-streamed on Comcast Channel 28 and on the City's website, barring technical difficulties. Those members of the public wishing to participate must do so remotely via Zoom electronic meetings in the following ways; by either logging onto the Zoom link located on the meeting agenda (please download the app to your computer or mobile device) and enter the meeting ID or by calling a listed number and enter the meeting ID. Public comment for Parks and Recreation Commission meetings will be accepted via email to publiccomment@cityofstheleena.org.

Please see the end of the agenda for detailed PUBLIC PARTICIPATION instructions.

Please click the link below to join the webinar:

<https://zoom.us/j/91461234863>

You are invited to a Zoom webinar.

When: Apr 20, 2020 04:30 PM Pacific Time (US and Canada)

Topic: St. Helena Parks & Recreation Commission April 2020 Meeting

Or iPhone one-tap :

US: +16699006833,,91461234863# or +13462487799,,91461234863#

Or Telephone:

Dial(for higher quality, dial a number based on your current location):

US: +1 669 900 6833 or +1 346 248 7799 or +1 301 715 8592 or +1 312 626 6799 or +1 929 205 6099 or +1 253 215 8782

Webinar ID: 914 6123 4863

International numbers available: <https://zoom.us/j/91461234863>

PLEASE NOTE: Any person who wishes to speak regarding an item on the agenda or make a comment under the "Oral Communication" portion of the agenda may do so, but please observe the time limit of four minutes.

Page

1. CALL TO ORDER
2. ROLL CALL
Commission Chair: Matt Demchuk
Vice Chair: Rebekah Weeman
Members: Bob Frescura, Susan Kenward, and Tye Taylor
City Council Member Liaison: David Knudsen
Staff Liaison: André Pichly, Parks & Recreation Director
3. PUBLIC FORUM:

An opportunity for the public to directly address the Commission on items of interest to the public that are not listed on the agenda. Any person addressing the Commission should provide his or her name and address, and limit comments to four minutes. Because of restrictions imposed by **the Brown Act, the Commission may not engage in substantive discussion, nor take action on matters not described on the agenda.**

4. REPORTS BY STAFF AND COMMISSION

Reports by staff and/or commission on items of general interest. Brief questions for clarification may be posed and answered, and Commission may request that items be placed on a future agenda. Except under certain circumstances, **the Brown Act prohibits any other discussion or action by the Parks and Recreation Commission.**

5. CONSENT CALENDAR:

Members of the Parks and Recreation Commission or the public may ask that any items be considered individually for purposes of considering alternative action, for extended discussion, or for public comment. Unless that is done, on motion may be used to adopt all recommendation actions.

5.1. February 24, 2020, meeting minutes unavailable for review until our next in-person meeting.

6. SCHEDULED MATTERS:

6.1. Endorsement of location and memorial wording of two benches to be placed in St Helena.

5 - 15

CEQA Determination: Not a CEQA project

Prepared By: Carlos Uribe, Assistant Public Works Operations Manager

[Draft wording Hovanesian PROOF](#)

[Sample contour bench with engraving](#)

[Donor bench location Adams st #1 LI](#)

[Donor bench location Adams st#2 LI](#)

[Donor Bench location Pope st #1 LI](#)

[Donor Bench location Pope st #2 LI](#)

6.2. Selection and endorsement of color options for 6 ADA compliant bottle filling drinking fountains; 2 of the drinking fountains include pet fountains. Endorsement will be forwarded to City Council for final approval.

17 - 36

CEQA Determination: Not a CEQA project

Prepared By: Clayton Church, Public Works Operations Manager

[Drinking Fountain Specifications](#)

[Color Chart for drinking fountains](#)

[Drinking Fountains staff report to Council 2-25-2020](#)

7. ADJOURNMENT

The next regular Parks and Recreation Commission meeting is scheduled for May 18, 2020, at 4:30 pm.

I do hereby certify that a copy of the foregoing agenda was posted on the City

website on Friday, April 17, 2020.

André Pichly, Parks & Recreation Director

In compliance with the Americans with Disabilities Act, if you need special assistance to participate in the meeting, please contact City Hall at (707) 967-2792. Notification 48 hours prior to the meeting will enable the City to make reasonable arrangements to ensure accessibility to this meeting (28 CFR35.102-35.104 ADA Title II). However, City staff will attempt to assist at any time with accessibility.

THE CITY OF ST. HELENA ENCOURAGES ONLINE PUBLIC PARTICIPATION IN VIRTUAL COMMISSION MEETINGS

St. Helena, CA– The City of St. Helena is committed to public participation in City government in a manner that is consistent with guidance provided by the Napa County Public Health Official and Governor Newsom's Executive Order N-25-20. These guidelines relate to social distancing, and are intended to protect everyone by limiting the spread of COVID-19 in our community. In adherence to these guidelines, the St. Helena Parks and Recreation Commission will host a Virtual Commission Meeting on Zoom; a free teleconferencing tool that enables users to watch and/or call into the meeting from their computers or phones. This meeting will be open to public and allows for live public comment. The meeting will also be recorded, livestreamed, and posted on the City's website after the adjournment of the meeting if technical difficulties occur:

[/Portal/](#)

The ZOOM web link, meeting ID, and phone number will be listed at the top of the Parks and Recreation Commission Meeting Agenda. You will be required to enter the meeting ID, but there will be no password or participant ID.

How to Watch or Listen to Commission Meetings:

1. Watch on Comcast Channel 28
2. Watch the livestreaming video on the City's website
3. Watch and Listen on Zoom.us by clicking on the link in the Parks and Recreation Commission Agenda
4. Listen only by calling the Zoom number listed on the Commission Agenda

Watch Commission Meeting by Joining the Zoom Meeting:

1. By Computer, Tablet, or Smart Phone:

- A. Before joining the virtual Commission Meeting, it is highly encouraged that you download the Zoom App. To sign up for your own free account, visit zoom.us/signup and enter your email address. You will receive an email from Zoom (no-reply@zoom.us). In this email, click Activate Account.
- B. If you are logged into your account, Enter the **Meeting ID** listed on the Commission Agenda. If you have not created an account go to: <https://zoom.us/join> and enter the **Meeting ID**
- C. Select if you would like to connect audio and/or video and tap **Join Meeting**.
- D. For specific instructions for your device, go to:

<https://support.zoom.us/hc/en-us/articles/201362193-Joining-a-Meeting>

2. **Listen Only by Telephone:**

- A. **Dial** the number listed on the Commission Agenda.
- B. At the prompt, enter the **Meeting ID** provided on the top of the Commission Meeting Agenda and **Press #**. **A participate ID is not required.**
- C. To disconnect from the meeting, hang up the phone.

Ways to Provide Public Comment:

While attending the virtual Parks and Recreation Commission Meeting, the public will have the opportunity to provide live public comment during Public Forum and after each agenda item. When it is the appropriate time for public comment the Mayor will verbally open public comment. At this time each individual is permitted 4 minutes to speak.

1. **Send a Public Comment in Advance to publiccomment@cityofsthelena.org**

The easiest way to provide public comment is to email your public comment. Public comments may be emailed to publiccomment@cityofsthelena.org. Please include in the subject line "COMMENT TO PARKS AND RECREATION COMMISSION and the AGENDA ITEM". Any public comment is required to be submitted no later than 1 hour before the scheduled meeting and will be included as an attachment to the agenda.

2. **Provide Comment through Zoom meeting from a computer, tablet, or smart phone**

This option allows the public to virtually attend the meeting as a muted 'attendee' with no video or screen sharing capabilities. You will be able to see and hear those participating in the meeting, but they will not be able to hear you until the host unmutes you.

If you wish to provide public comment during a specific agenda item or during public forum, you can use the "**raise hand**" feature located in the control panel at the bottom of your screen. The icon is a small blue hand. In Windows you can also use the Alt+Y keyboard shortcut to raise or lower your hand. In Mac you can also use the Option+Y keyboard shortcut to raise or lower your hand.

The host will be notified that you've raised your hand and you will be placed in a queue with all incoming requests.

When it is your turn to speak, you will be notified that the host has unmuted you. To be removed from the queue, just click the '**raise hand**' button again.

3. **Call in to the ZOOM meeting from a cell phone or landline phone only**

This option allows the member of the public with the opportunity to verbally participate in public comment.

If you wish to speak during public comment time dial ***9** on your telephone.

The host will be notified that you would like to speak and you will be placed in a queue with all incoming requests.


When it is your turn to speak, you will be notified that the host has unmuted you. You may press ***9** again if you wish to be removed from the queue.


You will be notified at the end of your statement that you have been muted.


PROOF 1 	PREFAB PRODUCT - LAYOUT PROOF FORM		DATE: 2-7-20
	CUSTOMER: St. Helena	FONT: times new roman	
	QUOTE or ORDER #: BIS20-0035	MATERIAL COLOR: cedar	
	PRODUCT DESCRIPTION: 6' contour bench in-ground mount	COLOR FILL: none - engraving	
	QUANTITY: 1		
Phone: 800-886-8990 Fax: 330-258-0167 Email: bdenker@brightideashops.com			
72" 5.5 Rudy Hovanesian 3.5 St. Helena Public Worker 1958-1977 3.5 Far from home he found a new life here			
PLEASE READ CAREFULLY CONTENT: After you review this layout for any omissions, errors, misrepresentations or misspellings please sign and date indicating your approval to move forward with production of your order. By signing this you are stating that the layout presentation, wording and font are correct and indicates your approval to move forward with production of the order. COLORS: The colors presented in this layout are representations of the colors that will appear of the end product. If you want to approve the end product's color we would recommend you request physical color sample be shipped to you to approve in person. TEXT: Engraved text may have a black outline when presented in your proof for the purpose of showing the letters clearly. This outline will not appear in the end product.			
CHECK THE APPROPRIATE BOX ☐ APPROVED ☐ CHANGES NEEDED			
CUSTOMER APPROVAL SIGNATURE: _____ DATE: _____			

Rudy Hovansian
St. Helena Public Worker 1958-1977
Far from home he found a new life here



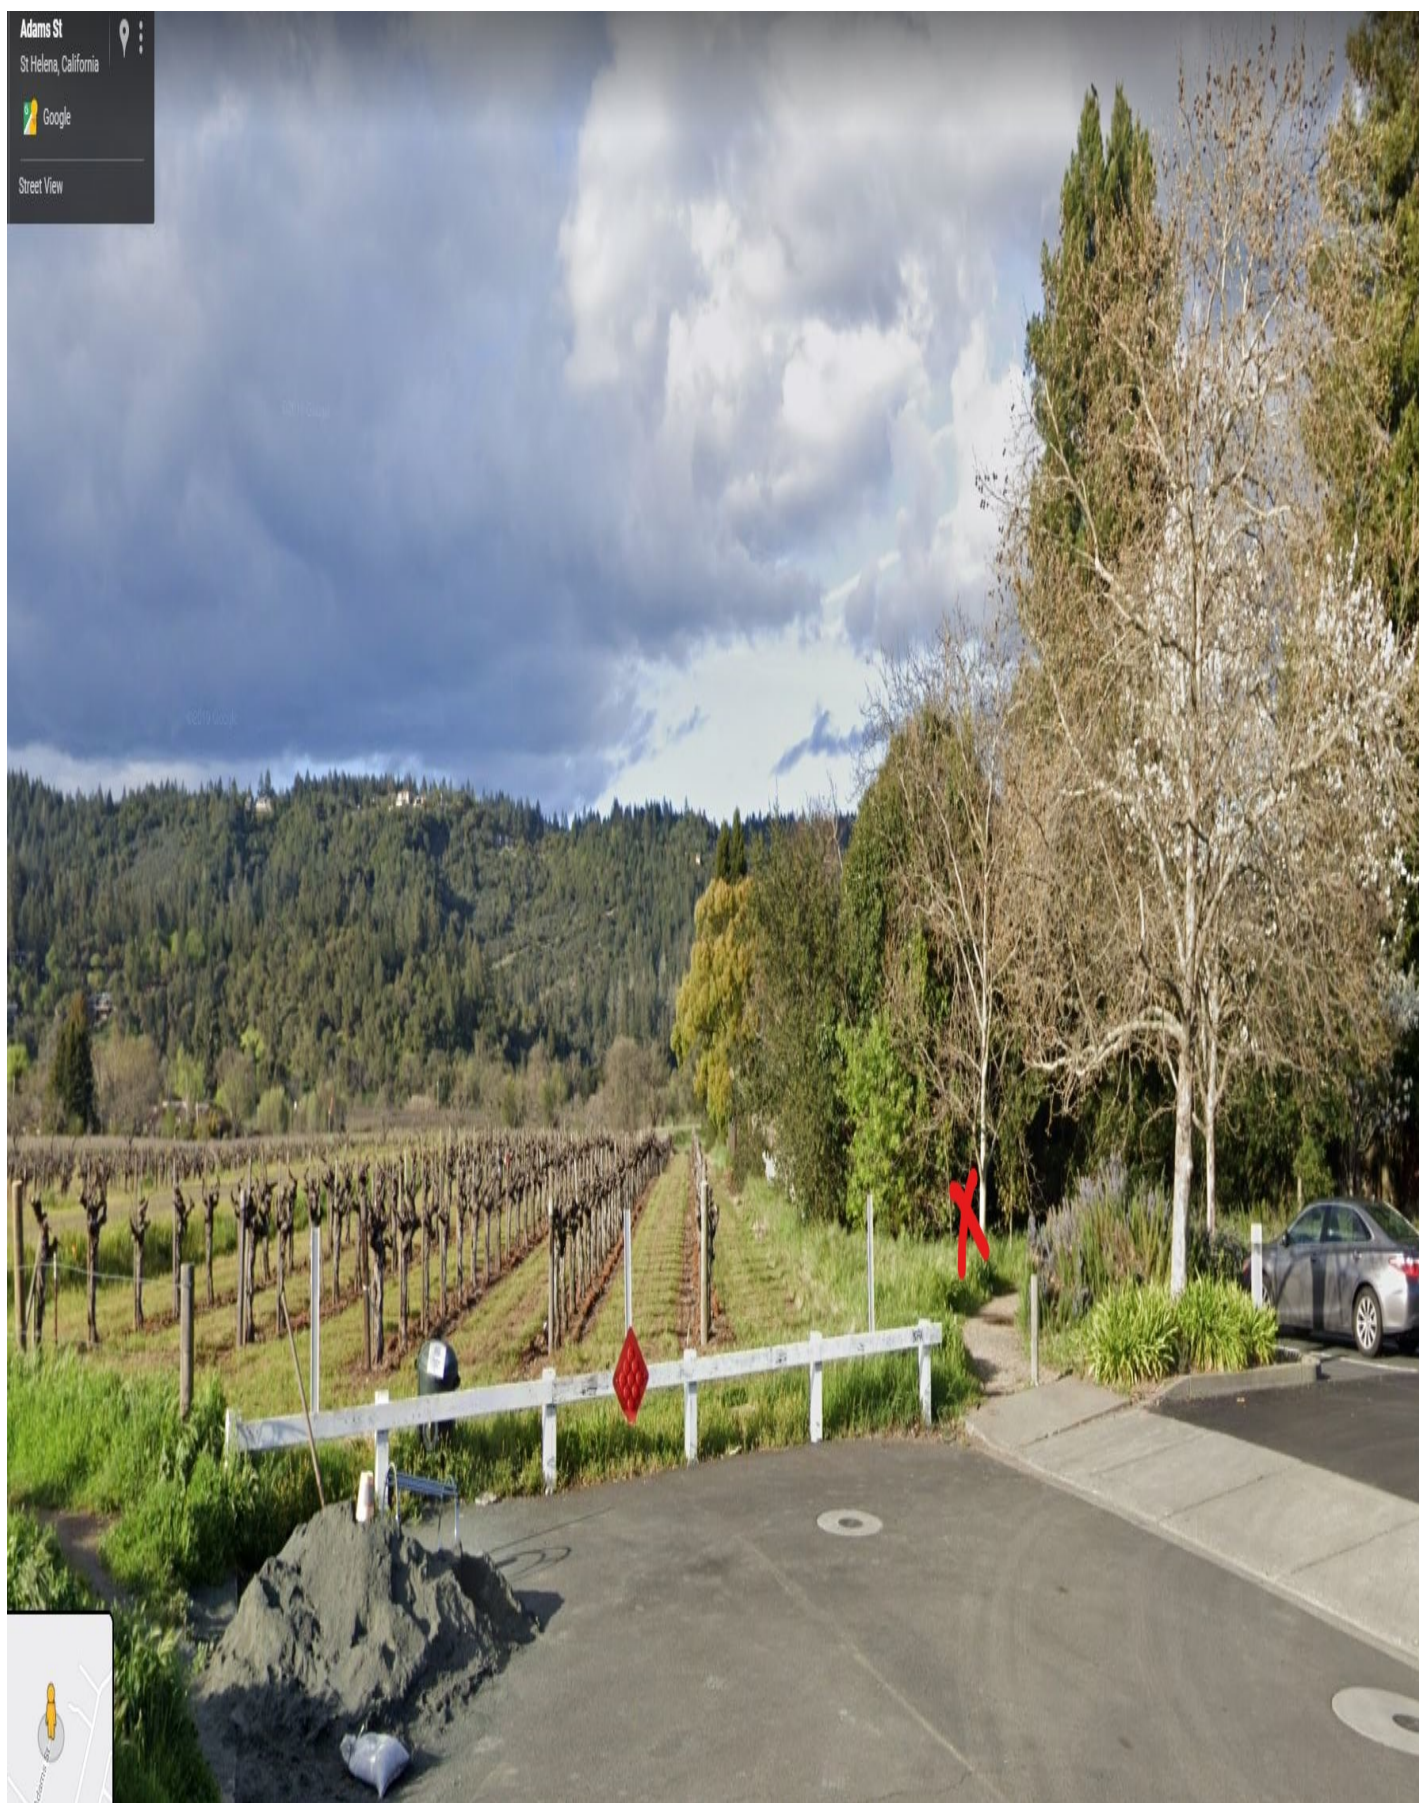

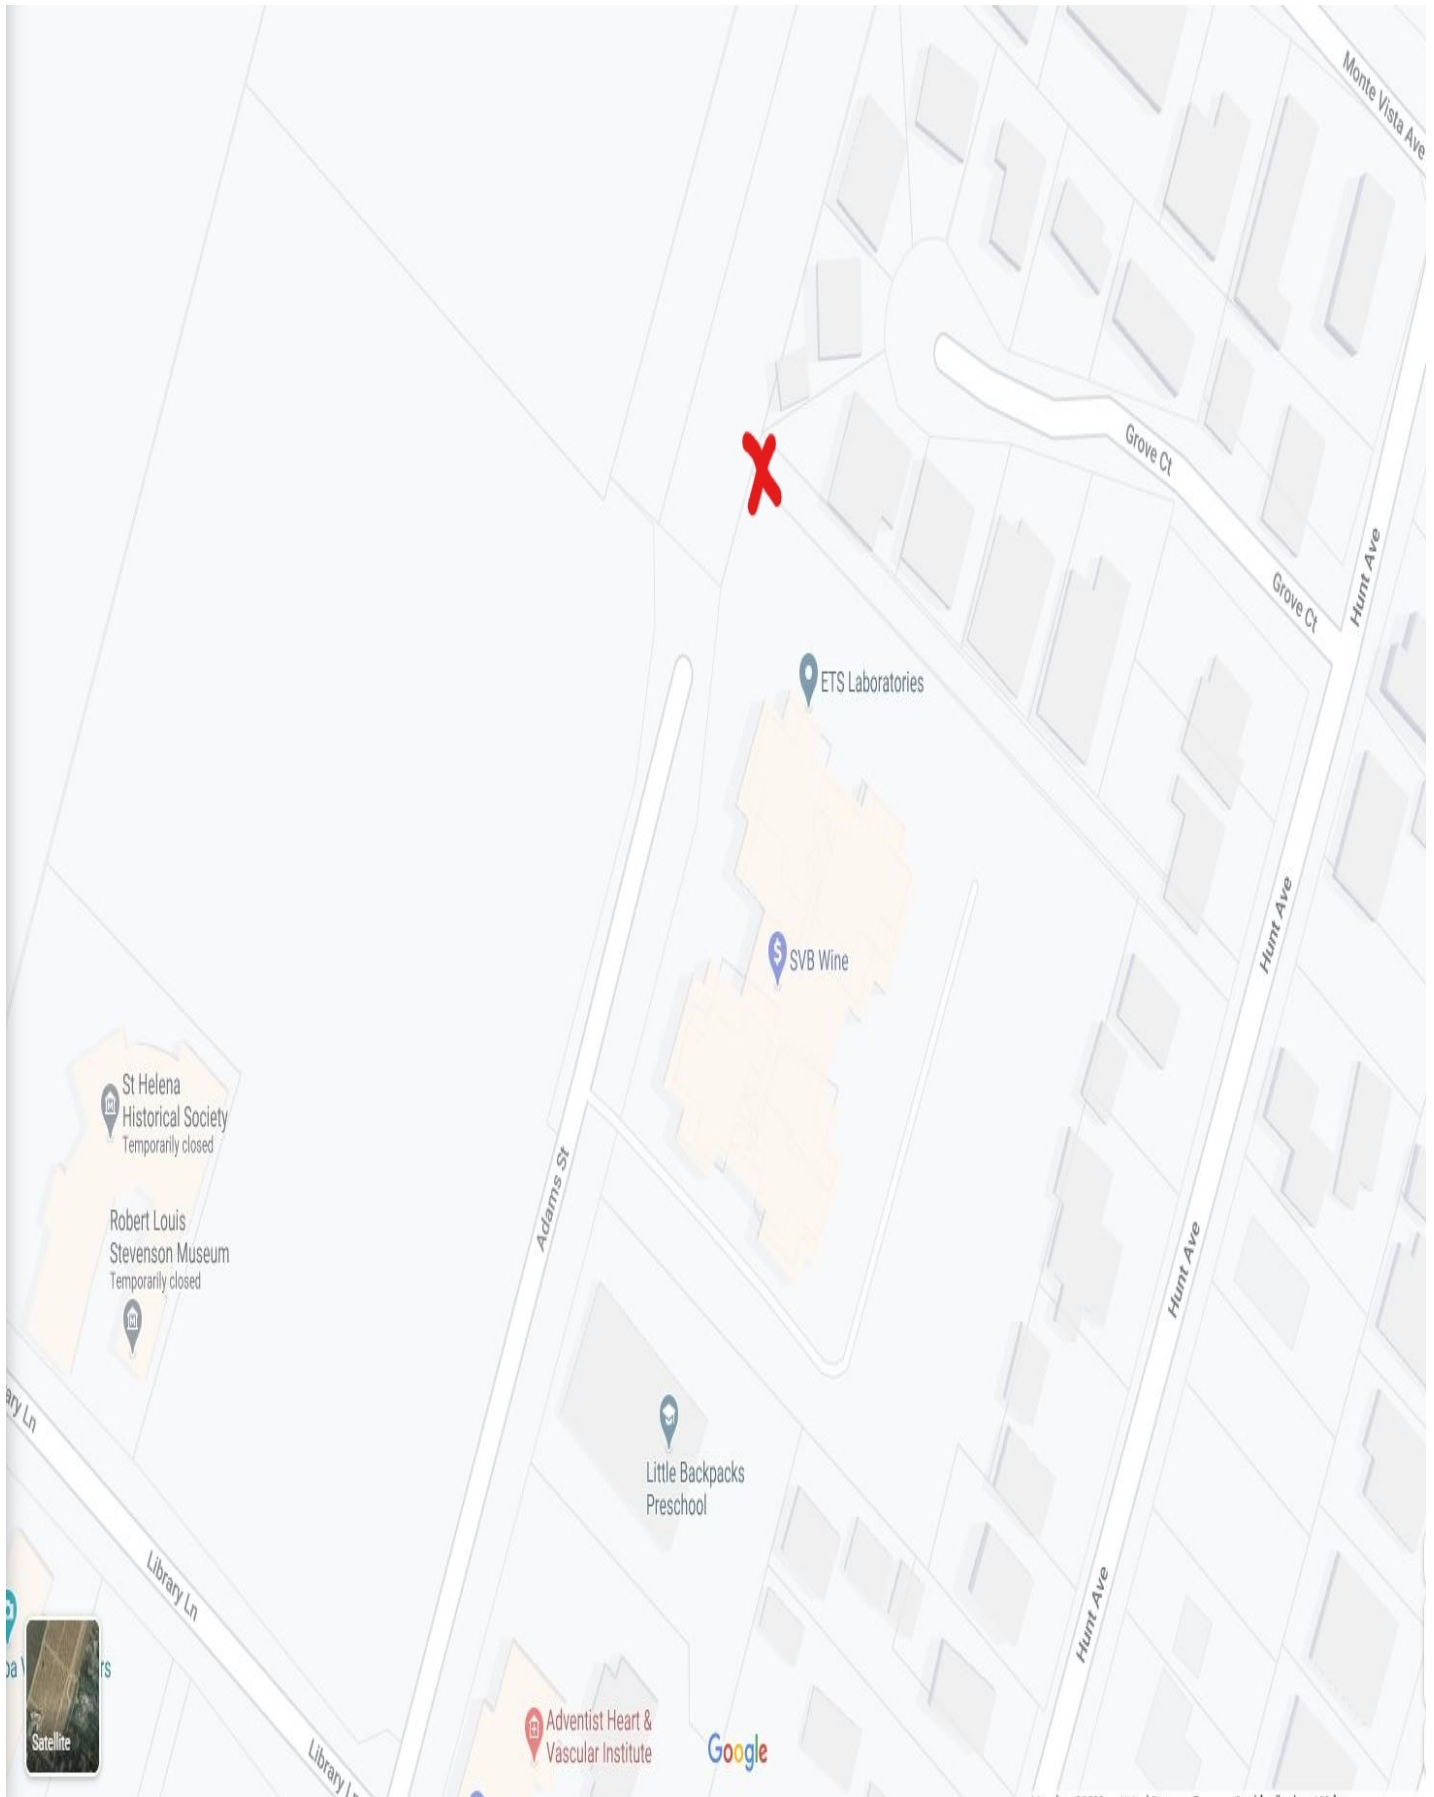

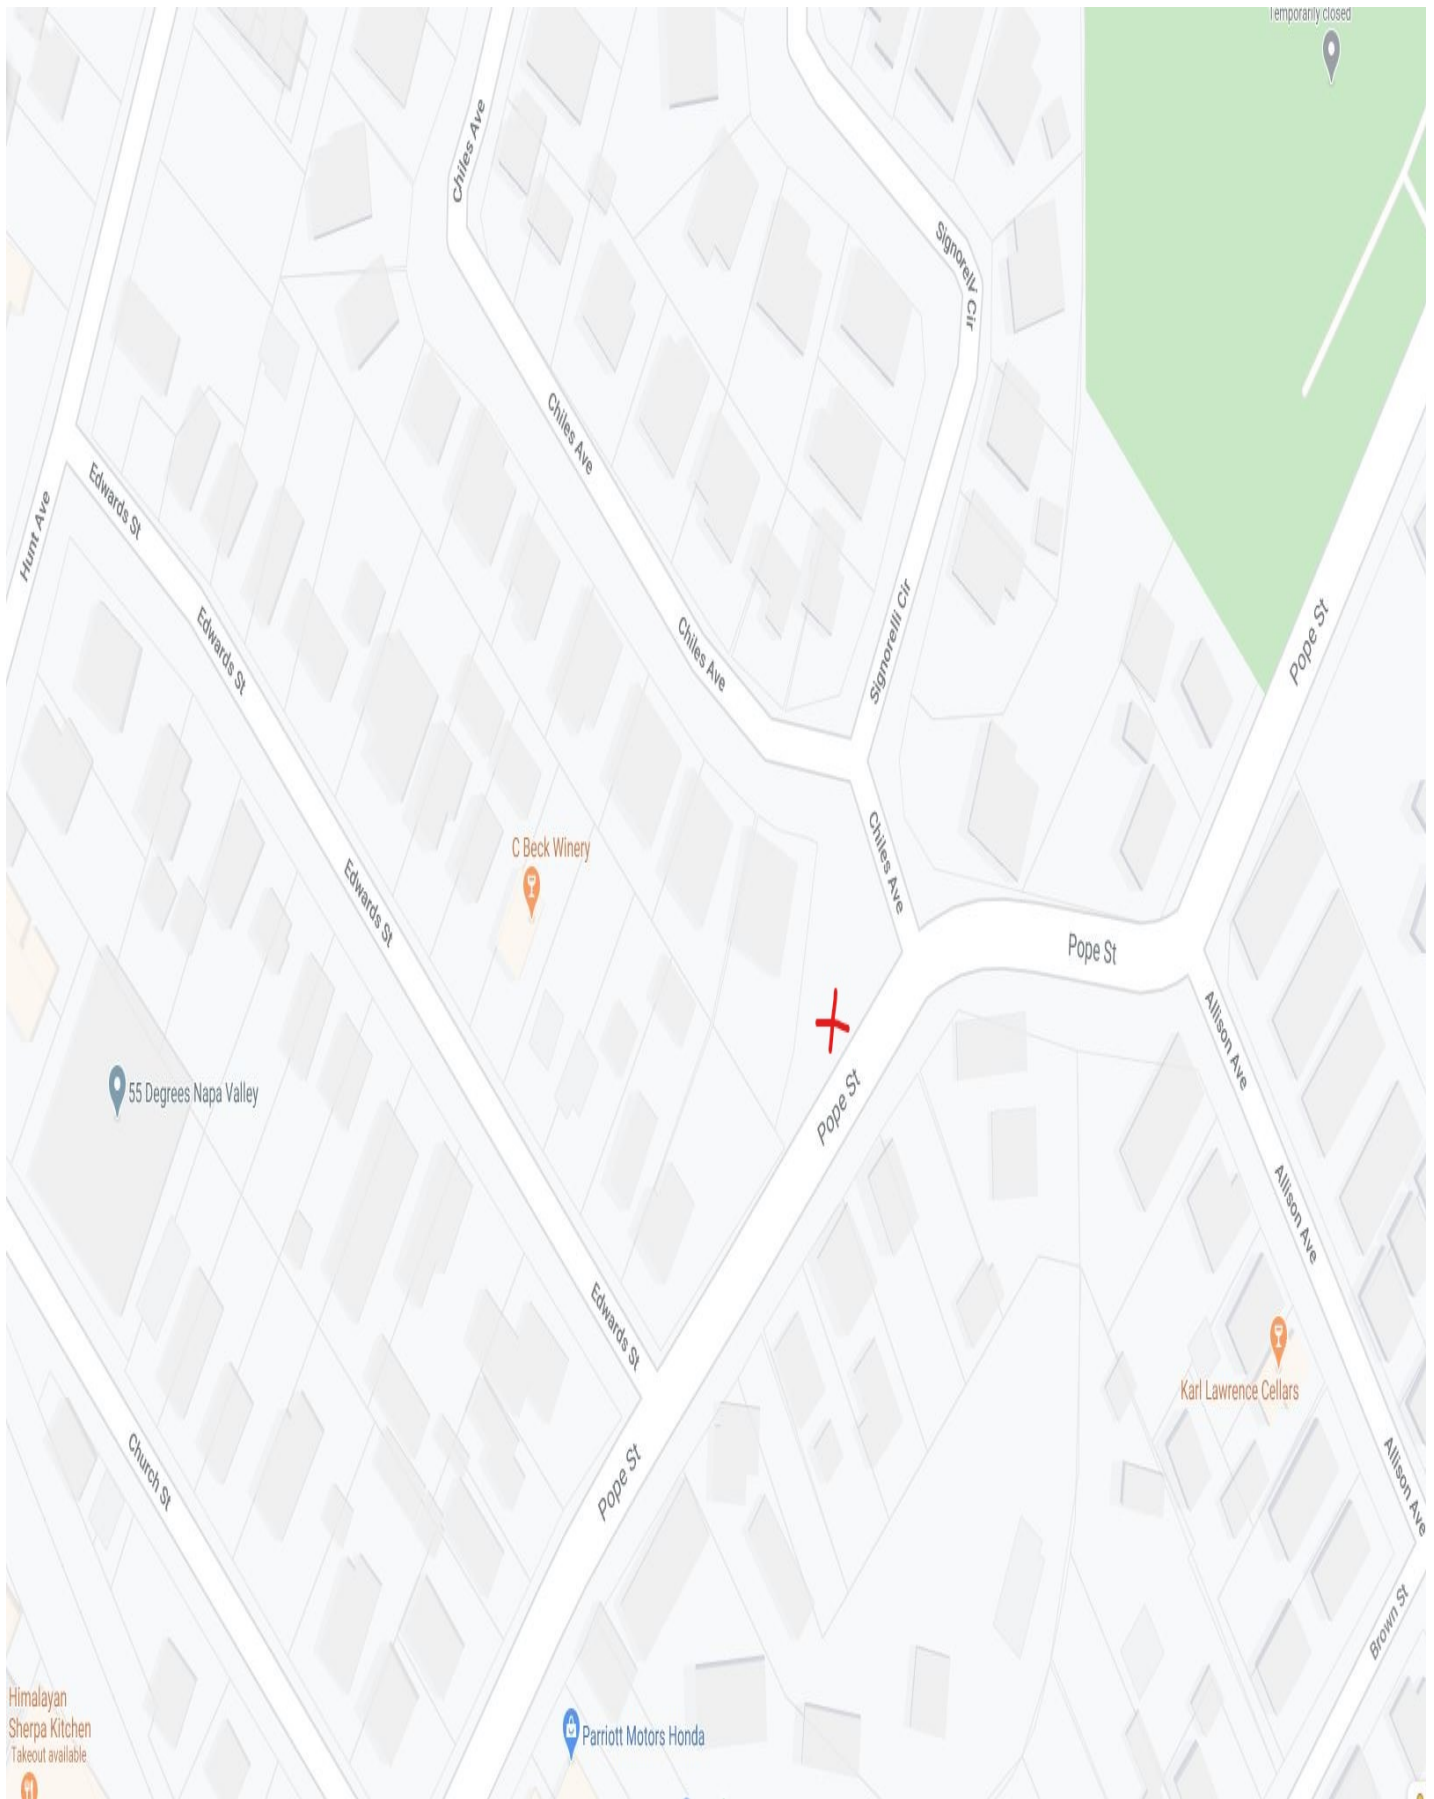




**Most
Dependable
Fountains, Inc.**


OPERATIONS MANUAL

**MODELS:
10145 SM & 10145 SMSS**

Most Dependable Fountains, Inc™
5705 Commander Drive
Arlington, TN 38002
901-867-0039
www.mostdependable.com

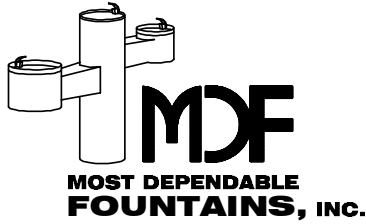


MOST DEPENDABLE FOUNTAINS, INC.
5705 COMMANDER DR. P.O. BOX 587
ARLINGTON, TN 38002-0587
PHONE: (901) 867-0039
www.mostdependable.com

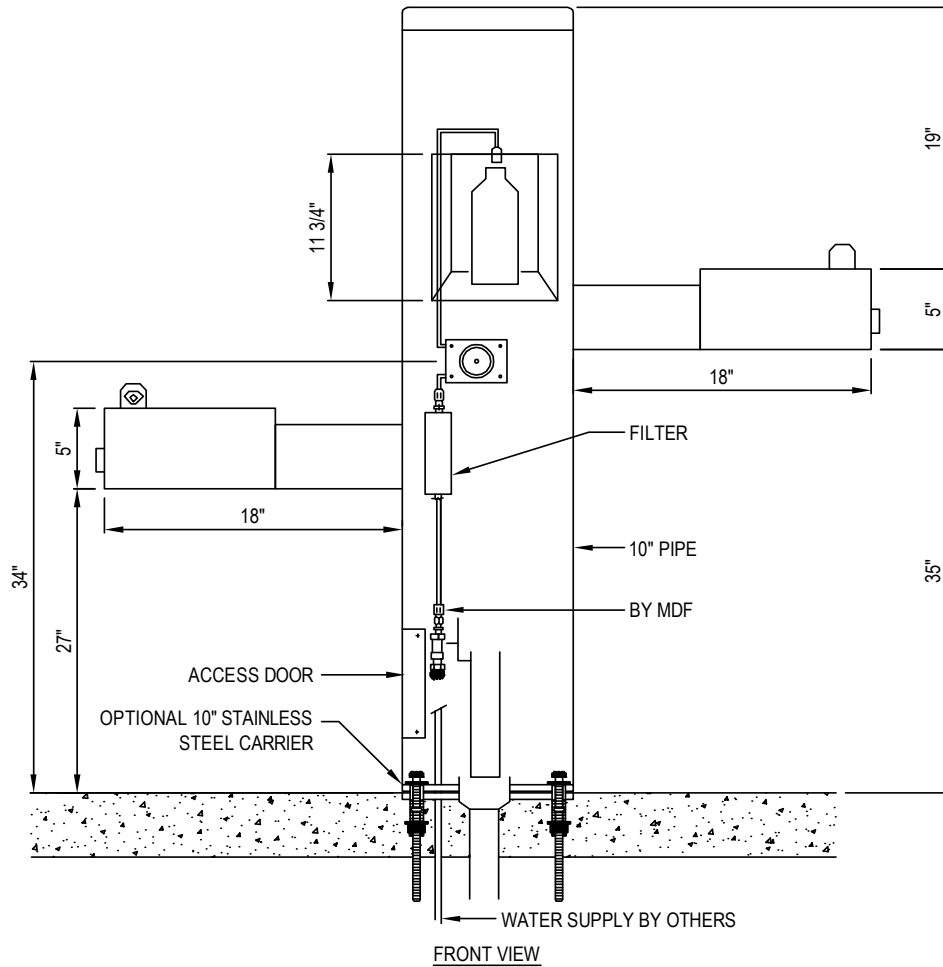

NOTES:

1. OPTIONAL STAINLESS STEEL SURFACE CARRIER RECOMMENDED.
2. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
3. DO NOT SCALE DRAWING.
4. THIS DRAWING IS INTENDED FOR USE BY ARCHITECTS, ENGINEERS, CONTRACTORS, CONSULTANTS AND DESIGN PROFESSIONALS FOR PLANNING PURPOSES ONLY. THIS DRAWING MAY NOT BE USED FOR CONSTRUCTION.
5. ALL INFORMATION CONTAINED HEREIN WAS CURRENT AT THE TIME OF DEVELOPMENT BUT MUST BE REVIEWED AND APPROVED BY THE PRODUCT MANUFACTURER TO BE CONSIDERED ACCURATE.
6. CONTRACTOR'S NOTE: FOR PRODUCT AND COMPANY INFORMATION VISIT www.CADdetails.com/info AND ENTER REFERENCE NUMBER 3354-17.8.



MODEL 10145SM

10145SM SHOWN WITH OPTIONAL 10" SS SURFACE CARRIER



3354-17.8

REVISION DATE 12/05/2016

PROTECTED BY COPYRIGHT © 2016 CADDETAILS.COM LTD.

CADdetails.com



PEDESTAL BOTTLE FILLER SPECIFICATIONS

WATER QUALITY (LEAD FREE)

Section 9, California Proposition 6 and the Federal Safe Drinking Water Act.
One piece weld construction with MDF standard 3/16" wall thickness.

■ STANDARD PEDESTAL

OR

■ STAINLESS STEEL PEDESTAL

RECEPTOR BOWL

One piece weld construction with MDF standard 304 schedule 10 stainless steel.
18 gauge electro-polished stainless steel bowl. Bowl overlaps pedestal, preventing buildup of residue in visual drinking area. Optional stainless steel Bowl Strainer recommended for areas with sand. Not applicable on Model 10125 SMSS.

BOTTLE FILLER SPOUT

Sanitary recessed nozzle.

BUBBLER HEAD

Stainless steel anti-squirt head (weighing a pound and a half) mounted with a lock nut and washer to prevent tampering. Lock nut pin holds bubbler in locked position to prevent twisting or turning. The MDF bubbler head has a unique design that features a steady stream trajectory and a built in natural shield from contamination.

PUSH BAR

304 stainless steel with circumference exceeding 8.6". Mushroom style push bar overlaps and prevents sand and other objects from sticking push bar in the ON position. Stainless steel bubbler housing standard.

CONTROL VALVE

Requires less than 5 lbs to operate. Non-cartridge O-ring valve delivers steady stream of water through an adjustable valve. This valve design is to operate and function at 30 to 80 PSI. Ideal operating pressure is 60 PSI.

WATER SUPPLY (LEAD FREE)

Maintenance free reinforced nylobraid tubing - **this tubing is not plastic**. It is supplied with a 1/2" MIP threaded inlet with stainless steel strainer. Union fittings at every connection. Supply line stops above grade. Water Filter is standard on this model.

DRAIN

1 1/2" schedule 40 PVC pipe. Drain line stops above grade.

FINISH

Oven baked powder coat. Choice of colors are: ☐ green, ☐ blue, ☐ black, ☐ red, ☐ yellow, ☐ orange, ☐ brown and ☐ white. Textured color choices: ☐ emerald, ☐ sapphire, ☐ pyrite, ☐ text-black, ☐ burgundy, ☐ gold vein, ☐ copper and ☐ sandstone. Stainless steel models are powder coated for added protection. The color ☐ chrome is an available option for stainless steel models only.

INSTALLATION

Surface Mount installation is designed to be anchored on top of a new or existing surface (concrete, etc.) For a new surface, a surface mount carrier is recommended. For an existing surface, anchor bolts are to be used through the attached mounting plate. Surface Mount Fountains come standard with an access door with vandal resistant stainless steel screws.

WINTERIZATION

Shut off water and drain down. Remove water filter.

WARRANTY

One year warranty, labor not included.

SHIPPING WEIGHT

Model 10125 SM..... 110 lbs	Model 10125 SMSS..... 100 lbs	Model 10890 SM..... 150 lbs
Model 10135 SM..... 150 lbs	Model 10135 SMSS..... 150 lbs	Model 10890 SMSS... 140 lbs
Model 10145 SM..... 245 lbs	Model 10145 SMSS..... 235 lbs	Model 10895 SM..... 200 lbs
Model 10150 SM..... 245 lbs	Model 10150 SMSS..... 235 lbs	Model 10895 SMSS... 190 lbs
Model 10155 SM..... 195 lbs	Model 10155 SMSS..... 185 lbs	

MOST DEPENDABLE FOUNTAINS, INC.™
5705 COMMANDER DR. • ARLINGTON, TN 38002-0587
www.mostdependable.com
(901) 867-0039



INSTALLATION INSTRUCTIONS

Most Dependable Fountains, Inc.[™]

All **SM (surface mount)** products are designed to be installed on the surface of a new or existing concrete slab. Your contractor needs to provide a 1 ½" PVC drain line (**when applicable**) and water line thru finish grade. Connections are made to our SM products thru our access door, as shown on detail drawings. The water tubing is provided with a ½" male iron pipe connection. This is an excellent location for a cutoff valve. Surface Mount units are anchored to the existing concrete by means of ½" concrete shields with bolts or we recommend ½" quick bolts.

Note: We offer an optional template which is designed to be poured in the concrete slab. It comes with the necessary vandal resistant stainless steel bolts and washers needed to anchor.

All **DB (direct bury)** products are designed to be installed to a depth of 14" below grade. MDF provides 1 ½" PVC drain line inside the pedestal (**when applicable**) to point of connection by others. MDF also provides reinforced nylobraid flexible tubing with a ½" male iron pipe thread for connection to water supply by others. MDF recommends an optional valve box using a PVC conduit to the pedestal. By using this option you have complete control of your product.

Individual detail drawings available Online or by request.



For more information:
Most Dependable Fountains, Inc.[™]
www.mostdependable.com
Info@mostdependable.com
901-867-0039

LIMITED PRODUCT WARRANTY

Most Dependable Fountains, Inc.[™]

Most Dependable Fountains, Inc.[™] warrants that all of its products are guaranteed against defective material or poor workmanship for a period of **one year from date of shipment**. Most Dependable Fountains, Inc.[™] liability under this warranty shall be discharged by furnishing without charge any goods, or part thereof, which shall appear to the Company upon inspection to be of defective material or not of first class workmanship. Most Dependable Fountains, Inc.[™] will not be liable for the cost of repairs, alterations or replacements, or for any expense connected therewith made by the owner or his agents. Most Dependable Fountains, Inc.[™] will not be liable for any damages caused by defective materials or poor workmanship, except for replacements, as provided above. Buyer agrees that Most Dependable Fountains, Inc.[™] has made no other warranties either expressed or implied in addition to those above stated. The products manufactured by Most Dependable Fountains, Inc.[™] is warranted to function if installation and maintenance instructions provided are adhered to. The units also must be used for the purpose for which they were intended.





Powder Coating Color Chart

Standard Finishes

SMOOTH: Available for Standard & Stainless Steel Units.



Green



Blue




Black



Red



Brown



White




Yellow




Orange

TEXTURED: Available for Standard & Stainless Steel Units.




Textured Emerald



Textured Sapphire




Textured Black




Textured Burgundy



Textured Pyrite



Textured Sandstone




Textured Gold Vein



Textured Copper

CHROME: Available for Stainless Steel Units Only.



Chrome

Colors on computer monitors vary greatly.
Please request a color card or paint sample.

Most Dependable Fountains, Inc.™ manufactures in Arlington, TN.

Our in house finishing facility allows customers to choose any of our standard colors. All colors with the exception of Chrome are available on regular steel products. All colors plus Chrome are available on stainless steel products.

It is the policy of Most Dependable Fountains, Inc. to powder coat all standard and stainless steel units.

Please contact Most Dependable Fountains, Inc. for more information.

901-867-0039

info@mostdependable.com

www.mostdependable.com



Report to the City Council
Regular City Council - 25 Feb 2020

Agenda Section: CONSENT ITEMS

Subject: Consideration and proposed approval of a Resolution authorizing the purchase of five Americans with Disabilities Act (ADA) compliant outdoor bottle filling station drinking fountains model 10145 SMSSFR in the amount of \$35,824.50 from Most Dependable Fountains, Inc.

CEQA Determination: Not a "project" as defined in CEQA Guidelines Section 15378(a); Common Sense exemption, as set forth in CEQA Guidelines Section 15061(b)(3).

Prepared By: Martin Beltran, Management Analyst

Reviewed By: Erica Ahmann Smithies, Public Works Director and City Engineer

Approved By: Mark T. Prestwich, City Manager

BACKGROUND

The City's 2017 adopted ADA Transition Plan (Plan) rated projects on a scale of one to three with one being the highest priority. In this Plan, water fountains are considered a third level priority and improving accessibility to City facilities (buildings, parks, and restrooms) a number one priority. However, as City facility improvements are made it is the intent to improve on other ADA upgrades as funding permits or as Building Code requires. In addition, the General Plan "Community Design" Chapter Implementing Action CD2.C calls for the implementation of attractive and well-designed community amenities such as drinking fountains in commercial areas. Recent facility improvements include the Lyman Park restrooms, Crane Park skatepark and tennis courts, and the new downtown restrooms.

City staff has also received input from the Active Transportation and Sustainability Committee, tennis court users, and other community members that bottle filling stations are highly desired instead of traditional drinking fountains. Installing bottle filling stations also encourages refillable bottle use and cuts down on plastic waste; therefore, City

staff specifically looked for drinking fountains that would include the bottle filling component.

DISCUSSION

Staff solicited quotes from three different vendors for five new ADA compliant drinking fountains. The drinking fountains will replace four existing drinking fountains, and add one additional drinking fountain. While researching potential drinking fountains and vendors, City staff asked nearby municipalities for suggestions and learned the City of Napa utilized Most Dependable Fountains for their recent drinking fountain upgrades.

The City received proposals from the following suppliers:

Morris Group International	\$21,765.00* (non-responsive)
Most Dependable Fountains, Inc.	\$35,824.50
Pace Supply, Inc.	\$55,490.60

*Did not meet all City requirements

City staff determined Most Dependable Fountains, Inc. has the lowest price, a positive recommendation from the City of Napa, and drinking fountain solutions that meet all of the City's requirements including:

- ADA Compliance
- Bottle Filler
- Freeze Resistance
- Front Approach
- Green Powder-Coated

The proposal is for five ADA compliant water fountains that includes freeze resistance and bottle filling station features. The freeze resistance feature is important to keep the drinking fountains functional year around and the bottle filling station feature helps the City take steps forward to sustainability goals and provide safe drinking water.

If approved, drinking fountains will be installed at the following locations:

Lyman Park: Two drinking fountains will be replaced in Lyman Park. The recent restroom renovation completed at the park triggered additional ADA upgrade requirements.

Crane Park: One of the drinking fountains will be installed within the recently renovated skate park and the other fountain is planned near the tennis courts.

C-82 Downtown Restroom Project: A drinking fountain is planned at the downtown restroom site in the Oak Avenue parking lot.

FISCAL IMPACT

The total cost to purchase the five ADA compliant outdoor bottle filling station drinking fountains is \$35,824.50. The adopted FY 2019-20 budget allocated \$103,000 in Capital Improvement Plan (CIP) Project: C18-83 ADA Plan Facilities.

RECOMMENDED ACTION

Staff recommends City Council adopt a resolution authorizing the purchase of five Americans with Disabilities Act (ADA) compliant Outdoor Bottle Filling Station Drinking Fountains model 10145 SMSSFR in the amount of \$35,824.50 from Most Dependable Fountains, Inc.

ATTACHMENTS

[Attachment 1: Resolution](#)

[Attachment 2: Most Dependable Fountains Quote](#)

[Attachment 3: Green Fountain](#)

[Attachment 4: Operations Manual](#)

CITY OF ST. HELENA

RESOLUTION No. 2020-

Resolution authorizing the purchase of five Americans with Disabilities Act (ADA) compliant outdoor bottle filling station drinking fountains model 10145 SMSSFR in the amount of \$35,824.50 from Most Dependable Fountains, Inc.

RECITALS

- A. The City of St. Helena's 2017 adopted ADA Transition Plan identifies the need to upgrade City amenities with ADA compliant drinking fountains; and
- B. Due to community feedback and recent facility improvements at the Lyman Park restrooms, downtown restroom, and the skate park; City staff obtained proposals for ADA compliant bottle filling drinking fountains; and
- C. The drinking fountains will be installed at Lyman Park (2), Crane Park (2), and downtown restroom project (1); and
- D. The purchase of the new equipment is budgeted in Fiscal Year 2019-20 from Capital Improvement Plan (CIP) Project: C18-83 ADA Plan Facilities; and
- E. The City of St. Helena Public Works Department is recommending the purchase of five ADA compliant outdoor bottle filling station drinking fountains model 10145 SMSSFR in the amount of \$35,824.50 from Most Dependable Fountains, Inc.

RESOLUTION

The City Council of the City of St. Helena hereby resolves as follows:

1. Approves the purchase of five Americans with Disabilities Act (ADA) compliant Outdoor Bottle Filling Station Drinking Fountains model 10145 SMSSFR in the amount of \$35,824.50 from Most Dependable Fountains, Inc.

Approved at a Regular Meeting of the St. Helena City Council on February 25, 2020, by the following vote:

Mayor Ellsworth: _____

Vice Mayor Dohring: _____

Councilmember Koberstein: _____


Councilmember Chouteau: _____

Councilmember Knudsen: _____

APPROVED: ATTEST:

Geoff Ellsworth, Mayor
Clerk

Cindy Tzaopoulos, City



**MOST DEPENDABLE
FOUNTAINS, INC.**

5705 Commander Dr. Arlington, TN 38002

Quote

Quote QTE51428
Date 1/29/2020
Page 1

Quoted by: Hayden
hayden@mostdependable.com
(901) 867-0039

Bill To:

CITY OF ST.HELENA
ST HELENA CA 94574

Ship To:

CITY OF ST HELENA
ST HELENA CA 94574

Purchase Order No.		Customer ID		Shipping Method		Payment Terms		Req Ship Date		Master No.	
		707-312-0951		FEDEX 85		NET 30		0/0/0000		106,460	
Quantity	Item Number	Description				UOM	Discount	Unit Price	Ext. Price		
5	10145 SMSSFR	10145 SMSSFR 250 lbs				EA		6,120.00	\$30,600.00		
		GREEN									
1.000	MISC ITEMS	MISC ITEMS				EA		0.00	\$0.00		
		BUILD FOR FRONT APPROACH									
1.000	CA SALES TAX	CA SALES TAX				EA		2,524.50	\$2,524.50		
		NAPA COUNTY 8.25%									
CURRENTLY PRODUCTION IS RUNNING OF 3-4 WEEKS. QUOTED BY HAYDEN ONE YEAR WARRANTY. LABOR NOT INCLUDED PRICES SUBJECT TO CHANGE WITHOUT NOTICE							Subtotal		\$33,124.50		
							Freight		\$2,700.00		
							Total		\$35,824.50		

Printed from Dynamics through PrintBoss




**Most
Dependable
Fountains, Inc.**


OPERATIONS MANUAL

**MODELS:
10145 SM & 10145 SMSS**

Most Dependable Fountains, Inc™
5705 Commander Drive
Arlington, TN 38002
901-867-0039
www.mostdependable.com

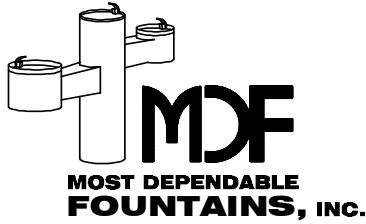


MOST DEPENDABLE FOUNTAINS, INC.
5705 COMMANDER DR. P.O. BOX 587
ARLINGTON, TN 38002-0587
PHONE: (901) 867-0039
www.mostdependable.com

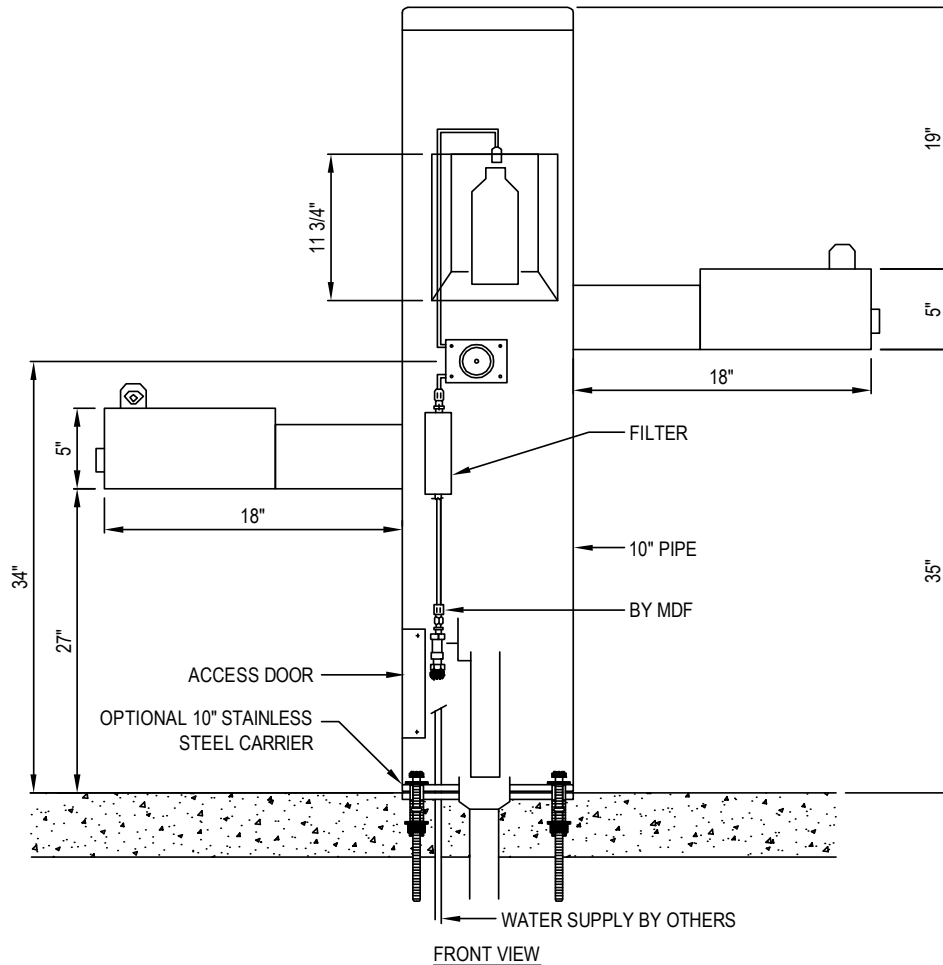

FRONT VIEW

NOTES:

1. OPTIONAL STAINLESS STEEL SURFACE CARRIER RECOMMENDED.
2. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
3. DO NOT SCALE DRAWING.
4. THIS DRAWING IS INTENDED FOR USE BY ARCHITECTS, ENGINEERS, CONTRACTORS, CONSULTANTS AND DESIGN PROFESSIONALS FOR PLANNING PURPOSES ONLY. THIS DRAWING MAY NOT BE USED FOR CONSTRUCTION.
5. ALL INFORMATION CONTAINED HEREIN WAS CURRENT AT THE TIME OF DEVELOPMENT BUT MUST BE REVIEWED AND APPROVED BY THE PRODUCT MANUFACTURER TO BE CONSIDERED ACCURATE.
6. CONTRACTOR'S NOTE: FOR PRODUCT AND COMPANY INFORMATION VISIT www.CADdetails.com/info AND ENTER REFERENCE NUMBER 3354-17.8.



MODEL 10145SM

10145SM SHOWN WITH OPTIONAL 10" SS SURFACE CARRIER



3354-17.8

REVISION DATE 12/05/2016

PROTECTED BY COPYRIGHT © 2016 CADDETAILS.COM LTD.

CADdetails.com



PEDESTAL BOTTLE FILLER SPECIFICATIONS

WATER QUALITY (LEAD FREE)

Section 9, California Proposition 6 and the Federal Safe Drinking Water Act.
One piece weld construction with MDF standard 3/16" wall thickness.

STANDARD PEDESTAL
OR

STAINLESS STEEL PEDESTAL

RECEPTOR BOWL

One piece weld construction with MDF standard 304 schedule 10 stainless steel.
18 gauge electro-polished stainless steel bowl. Bowl overlaps pedestal, preventing buildup of residue in visual drinking area. Optional stainless steel Bowl Strainer recommended for areas with sand. Not applicable on Model 10125 SMSS.

BOTTLE FILLER SPOUT

Sanitary recessed nozzle.

BUBBLER HEAD

Stainless steel anti-squirt head (weighing a pound and a half) mounted with a lock nut and washer to prevent tampering. Lock nut pin holds bubbler in locked position to prevent twisting or turning. The MDF bubbler head has a unique design that features a steady stream trajectory and a built in natural shield from contamination.

PUSH BAR

304 stainless steel with circumference exceeding 8.6". Mushroom style push bar overlaps and prevents sand and other objects from sticking push bar in the ON position. Stainless steel bubbler housing standard.

CONTROL VALVE

Requires less than 5 lbs to operate. Non-cartridge O-ring valve delivers steady stream of water through an adjustable valve. This valve design is to operate and function at 30 to 80 PSI. Ideal operating pressure is 60 PSI.

WATER SUPPLY (LEAD FREE)

Maintenance free reinforced nylobraid tubing - **this tubing is not plastic**. It is supplied with a 1/2" MIP threaded inlet with stainless steel strainer. Union fittings at every connection. Supply line stops above grade. Water Filter is standard on this model.

DRAIN

1 1/2" schedule 40 PVC pipe. Drain line stops above grade.

FINISH

Oven baked powder coat. Choice of colors are: ☐ green, ☐ blue, ☐ black, ☐ red, ☐ yellow, ☐ orange, ☐ brown and ☐ white. Textured color choices: ☐ emerald, ☐ sapphire, ☐ pyrite, ☐ text-black, ☐ burgundy, ☐ gold vein, ☐ copper and ☐ sandstone. Stainless steel models are powder coated for added protection. The color ☐ chrome is an available option for stainless steel models only.

INSTALLATION

Surface Mount installation is designed to be anchored on top of a new or existing surface (concrete, etc.) For a new surface, a surface mount carrier is recommended. For an existing surface, anchor bolts are to be used through the attached mounting plate. Surface Mount Fountains come standard with an access door with vandal resistant stainless steel screws.

WINTERIZATION

Shut off water and drain down. Remove water filter.

WARRANTY

One year warranty, labor not included.

SHIPPING WEIGHT

Model 10125 SM.....	110 lbs	Model 10125 SMSS.....	100 lbs	Model 10890 SM.....	150 lbs
Model 10135 SM.....	150 lbs	Model 10135 SMSS.....	150 lbs	Model 10890 SMSS...	140 lbs
Model 10145 SM....	245 lbs	Model 10145 SMSS.....	235 lbs	Model 10895 SM.....	200 lbs
Model 10150 SM....	245 lbs	Model 10150 SMSS.....	235 lbs	Model 10895 SMSS...	190 lbs
Model 10155 SM....	195 lbs	Model 10155 SMSS.....	185 lbs		

MOST DEPENDABLE FOUNTAINS, INC.™
5705 COMMANDER DR. • ARLINGTON, TN 38002-0587
www.mostdependable.com
(901) 867-0039



INSTALLATION INSTRUCTIONS

Most Dependable Fountains, Inc.™

All **SM (surface mount)** products are designed to be installed on the surface of a new or existing concrete slab. Your contractor needs to provide a 1 ½" PVC drain line (**when applicable**) and water line thru finish grade. Connections are made to our SM products thru our access door, as shown on detail drawings. The water tubing is provided with a ½" male iron pipe connection. This is an excellent location for a cutoff valve. Surface Mount units are anchored to the existing concrete by means of ½" concrete shields with bolts or we recommend ½" quick bolts.

Note: We offer an optional template which is designed to be poured in the concrete slab. It comes with the necessary vandal resistant stainless steel bolts and washers needed to anchor.

All **DB (direct bury)** products are designed to be installed to a depth of 14" below grade. MDF provides 1 ½" PVC drain line inside the pedestal (**when applicable**) to point of connection by others. MDF also provides reinforced nylobraid flexible tubing with a ½" male iron pipe thread for connection to water supply by others. MDF recommends an optional valve box using a PVC conduit to the pedestal. By using this option you have complete control of your product.

Individual detail drawings available Online or by request.



For more information:
Most Dependable Fountains, Inc.™
www.mostdependable.com
Info@mostdependable.com
901-867-0039

LIMITED PRODUCT WARRANTY

Most Dependable Fountains, Inc.[™]

Most Dependable Fountains, Inc.[™] warrants that all of its products are guaranteed against defective material or poor workmanship for a period of **one year from date of shipment**. Most Dependable Fountains, Inc.[™] liability under this warranty shall be discharged by furnishing without charge any goods, or part thereof, which shall appear to the Company upon inspection to be of defective material or not of first class workmanship. Most Dependable Fountains, Inc.[™] will not be liable for the cost of repairs, alterations or replacements, or for any expense connected therewith made by the owner or his agents. Most Dependable Fountains, Inc.[™] will not be liable for any damages caused by defective materials or poor workmanship, except for replacements, as provided above. Buyer agrees that Most Dependable Fountains, Inc.[™] has made no other warranties either expressed or implied in addition to those above stated. The products manufactured by Most Dependable Fountains, Inc.[™] is warranted to function if installation and maintenance instructions provided are adhered to. The units also must be used for the purpose for which they were intended.

